



Are you ready for energy savings? Enable our cloud-based energy analytics and dashboard for your [Schneider Com'X 510 Gateway](#), to discover, measure and verify savings in the premises you manage.

It is assumed that your Com'X 510 Gateway already collects data from your meter(s). If not, read and understand Schneider manuals for installing, operating, or maintaining your Com'X 510 Gateway. Installation and program procedures must be carried out and inspected by qualified personnel. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with this product.

Step 1: Register your gateway and data points with Wattics


[Register your Schneider Com'X 510 Gateway](#)

One of our tech support representatives will register your Com'X 510 gateway, will set up your monthly subscription fee, and will give you access to the Wattics dashboard. You will

also receive **username** and **password** to use when setting up the gateway to send log files to the Wattics FTP server.

Step 2: Configure your Com'X 510 Gateway

The EGX300 allows you to export device logs by FTP.

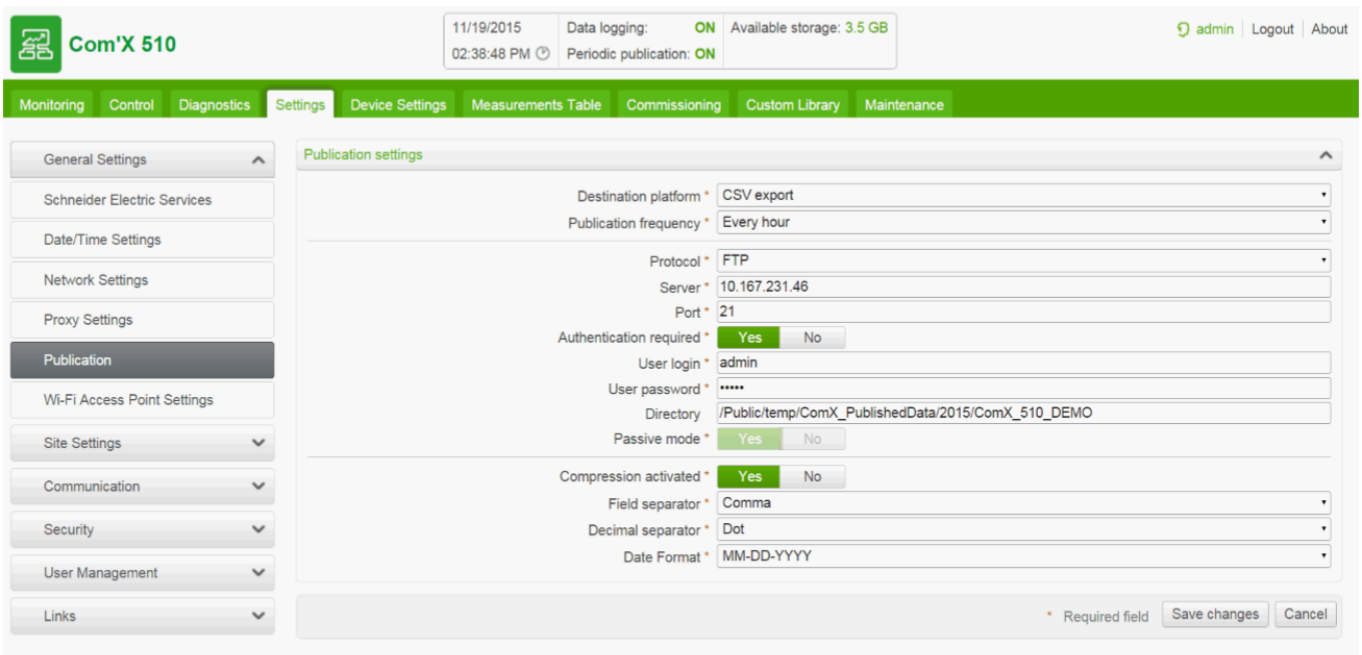

The screenshot shows the Com'X 510 web interface. The top navigation bar includes Monitoring, Control, Diagnostics, Settings, Device Settings, Measurements Table, Commissioning, Custom Library, and Maintenance. The Settings menu is expanded to show Publication settings. The Publication settings page includes the following fields:

- Destination platform: CSV export
- Publication frequency: Every hour
- Protocol: FTP
- Server: 10.167.231.46
- Port: 21
- Authentication required: Yes (selected)
- User login: admin
- User password: *****
- Directory: /Public/temp/ComX_PublishedData/2015/ComX_510_DEMO
- Passive mode: Yes (selected)
- Compression activated: Yes (selected)
- Field separator: Comma
- Decimal separator: Dot
- Date Format: MM-DD-YYYY

At the bottom right, there is a "Required field" indicator and buttons for "Save changes" and "Cancel".


1. Connect to your Com'X 510 webpage by entering the Com'X 510 IP address into a browser address bar. The default login credentials are:

- Username: admin
- Password: admin

2. Go to **Settings > General Settings > Publication**

3. Select **CSV** as the **Destination platform** in the drop-down list
4. Select how often you want the data logs to be exported to Wattics: **Hourly, Daily, Weekly, Monthly, or Logging interval**. Wattics supports all time intervals so you can select based on your requirements.
5. Select **FTP** as the **Protocol**.
6. In the **Server** field, enter **ftp01.wattics.com**
7. In the **Port** field, enter **21**
8. Click **Yes** for **Authentication Required**
9. For **User login** and **User password**, enter the **username** and **password** provided by Wattics
10. For the **Directory** field, enter **source**
11. Set the **Passive** check box to **Yes**.
12. Set **Compression activated** to **No**.
13. Set **Field separator** to **Comma**.
13. Set **Decimal separator** to **Dot**.
14. Set **Date Format** to **DD-MM-YYYY**.
13. Click **Save changes** to save the FTP Export configuration.

Your data logs will now be sent to Wattics, log in to your dashboard and get started!

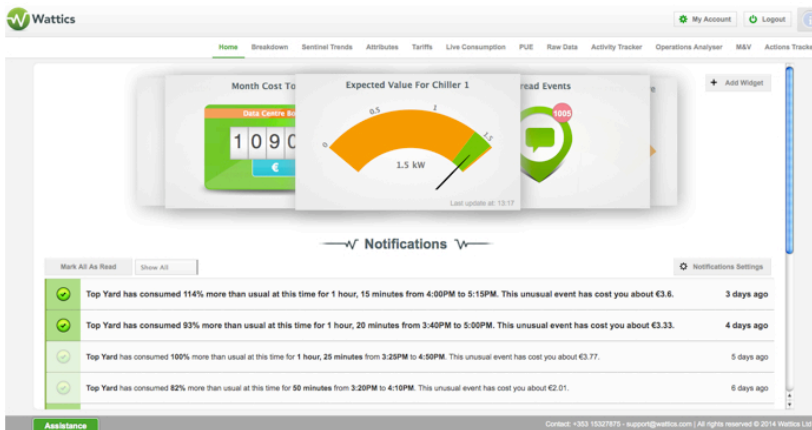

+353 (0)1415 1242 | info@wattics.com | [Contact us](#)